


NOTE: BACKFLOW PREVENTION IS REQUIRED,

11/9/90 DKR

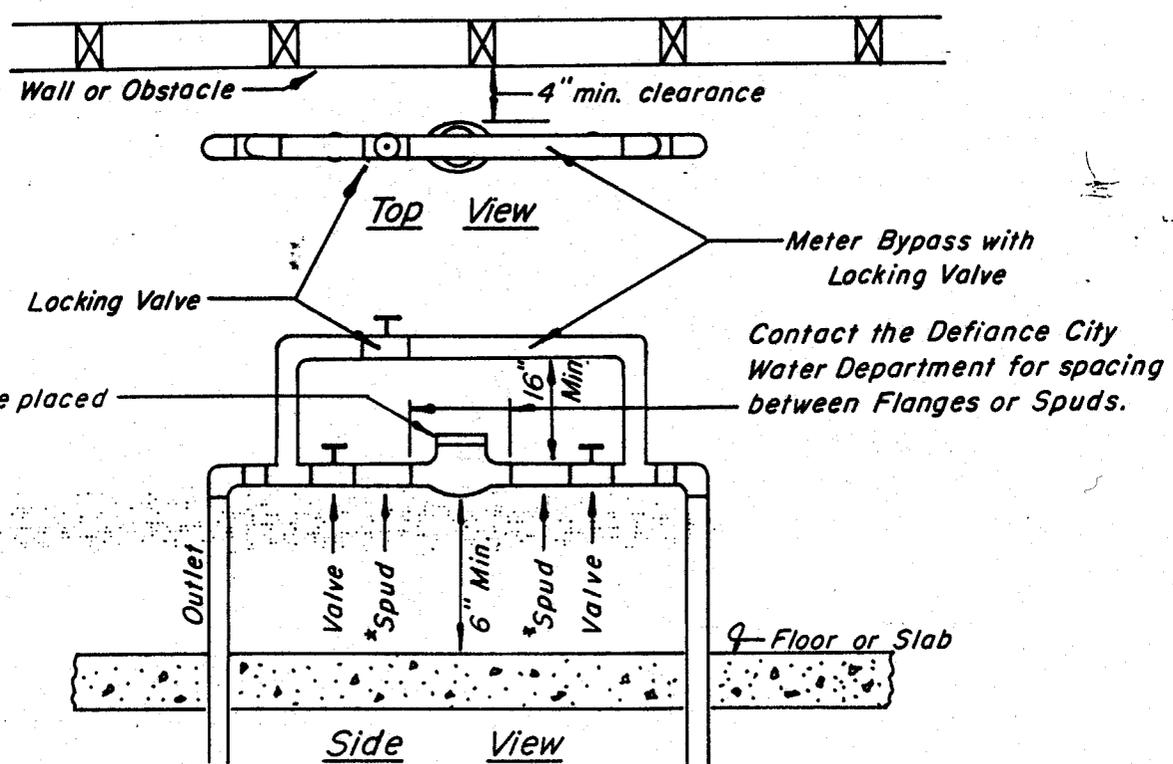

Standard 2" & Larger Water Meter Installation Detail

NOTES: (WHERE REQUIRED)

- 1.) Remote meter reader wire shall be installed before meter is requested to be placed. Minimum wire size 20-2 (insulated) Maximum wire size 18-2 (insulated) Wire shall be placed and protected from the meter location to an outside wall. Run through the outside wall at an elevation between 4' and 5' above finished grade.
- 2.) Meters shall be located to be protected from freezing and must be easily accessible. They are not to be placed in crawl spaces. Locations are to be approved by Meter Serviceman.
- 3.) Curb stops are to be operated by City employees only. Violators are subject to penalty.
- 4.) Only copper water lines are permitted for inside plumbing.
- 5.) There shall be a min. of 18" of pipe on each end of the meter without fittings for better flow through the meter.

<b>STANDARD DRAWING</b>		
<b>Water Meter Installation No.2</b>		
CITY ENGINEER	DRAWN BY	DATE
GAYLON L. DAVIS	R.O.F	JUNE 1979
REVISIONS		

\*Spuds or flanges are furnished by City with meter. Obtain from Building inspection Department or Water Billing Office.