

SPRINKLER
FLOW

BACKFLOW DEVICE ASSEMBLY SHALL BE APPROVED BY THE
WATER SUPERINTENDENT AND THE CITY PLUMBING INSPECTOR.

ALL PIPING MUST BE APPROVED BY THE CITY PLUMBING
INSPECTOR

ALL METERS MUST BE POSITIONED HORIZONTALLY AND
PROVIDE CONVENIENT ACCESS AND READING

FLANGES AND SPUDS ARE FURNISHED BY THE CITY WITH
METER OBTAINED FROM THE UTILITY BILLING OFFICE.

THE PROPERTY OWNER SHALL BE RESPONSIBLE FOR LOCATION,
INSTALLATION, AND EXPENSE FOR THE BACKFLOW PREVENTOR
ON ALL METERS OVER 3/4" IN SIZE.

METERS SHALL BE LOCATED TO BE PROTECTED FROM FREEZING
AND MUST BE EASILY ACCESSIBLE. THEY ARE NOT TO BE PLACED
IN CRAWL SPACES.

WATCH VALVES ON CITY SIDE ARE TO BE OPERATED BY CITY
EMPLOYEES ONLY. VIOLATORS ARE SUBJECT TO PENALTY.

ALL PIPING AND HARDWARE MUST BE A.W.W.A. APPROVED.

A

B

D


LAWN
SPRINKLER
METER

A) GATE VALVE

B) DOMESTIC METER

C) NO. 7 WATTS - DOUBLE CHECK BACKFLOW
PREVENTION DEVICE.

D) OPTION OF VALVE USE IN THIS LOCATION.

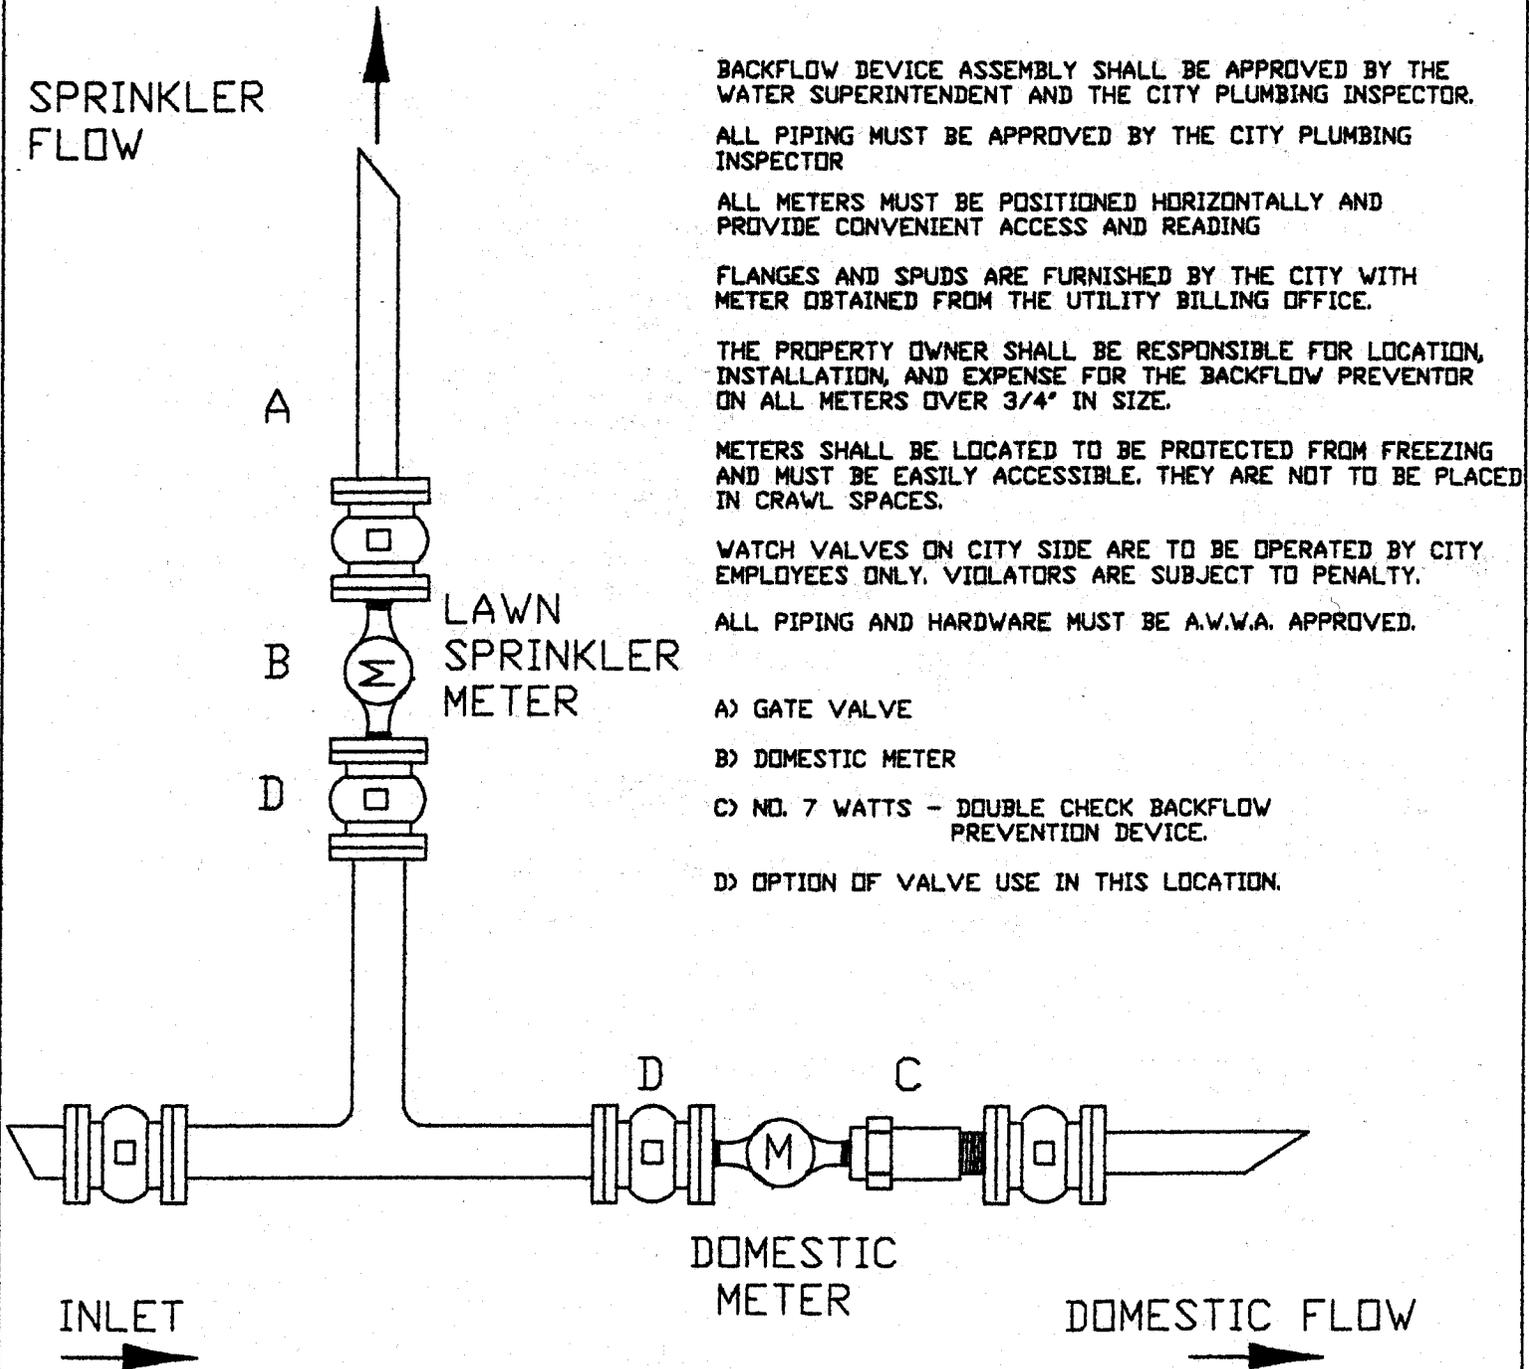

DOMESTIC
METER

DOMESTIC FLOW

RESSPRMT

REVISIONS		DEFIANCE CITY ENGINEER'S OFFICE CHERYLE F. CULLER P. E.	
1		RESIDENTIAL / SPRINKLER METER	
2		DRAWN BY R.L.T.	SCALE NONE
3		CHK'D	DATE FEB. 1993
4		TRACED	APP'D
5			MATERIAL
6			DRAWING NO.